


**PLAN VIEW**

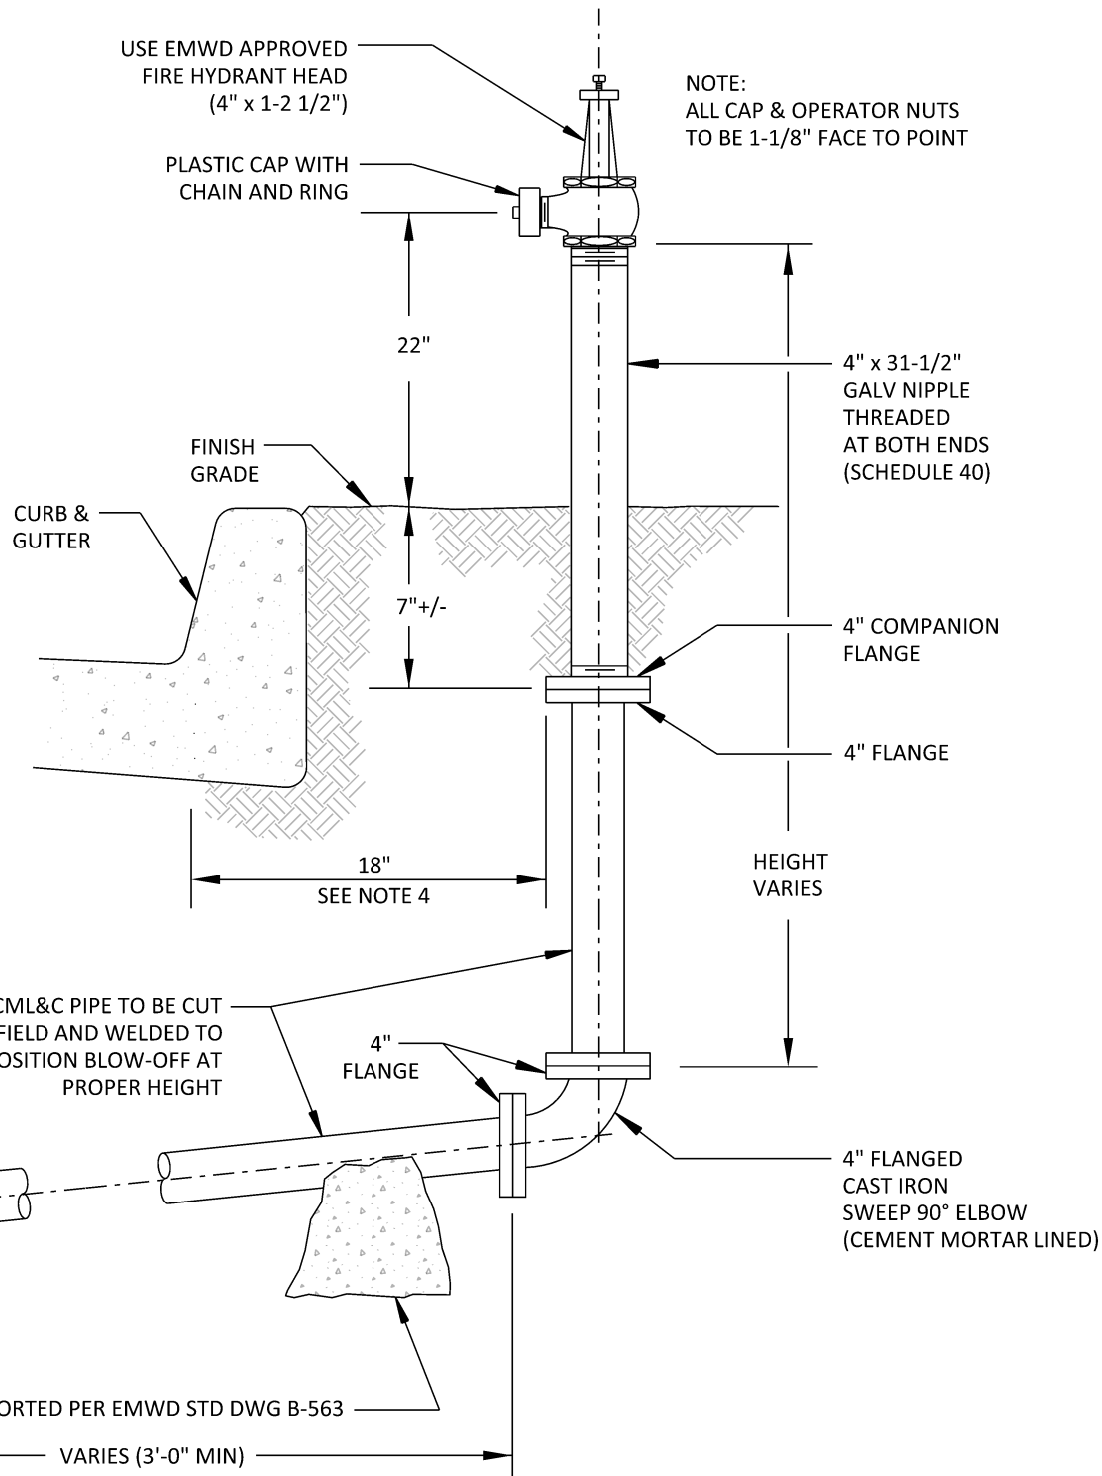

**BLOW-OFF ASSEMBLY-PROFILE**

**NOTES:**

1. BLOW-OFF TO BE PAINTED APPROVED YELLOW.
2. ALL FLANGES SHALL BE FULL WELDED (DOUBLE PASS) AND COATED IN THE FIELD AS DIRECTED BY THE ENGINEER IN NOTE 5.
3. ALTERNATE MATERIALS MAY BE USED WHEN SPECIFIED.
4. BLOW-OFF PLACEMENT: TEMPORARY BLOW-OFFS SHALL BE LOCATED SO AS NOT TO INTERFERE WITH FUTURE IMPROVEMENTS THAT WILL BE INSTALLED PRIOR TO THE WATER MAIN EXTENSION.
5. FIELD COATING FOR EXPOSED PIPE SHALL BE PER EMWD SPECIFICATIONS AND APPROVED MATERIALS.

REVISIONS				APPROVALS			EASTERN MUNICIPAL WATER DISTRICT STANDARD DRAWING		
NO.	DATE	INITIAL	DESCRIPTION	APP'D	DATE	DESIGN	INITIAL	DATE	
4	4/23/21	GS	UPDATED TITLE BLOCK, LOGO AND FONT	AGA	4/23/21	CONSTRUCTION			
3	5/18/00	GR	REVISED ALL FONT	VJB	5/19/00	INSPECTION			
2	5/13/94		REVISED BLOW-OFF SYMBOL	VJB	5/19/93	OPERATIONS	PK	5/18/93	
1	4/15/93		REDRAWN W/CADD ON MYLAR	VJB	5/19/93	SUBMITTED	VJB	5/19/93	
REFERENCES: FILE I.D.: \kauai\eng\std dwgs\B-561.dgn				SCALE: NONE		RECOMMENDED <i>Joseph D. Van Sickle</i> 6/1/93 DIRECTOR OF ENGINEERING DATE		APPROVED <i>G. Hooite Rugge</i> 7/2/93 CHIEF ENGINEER DATE	

**4"x1-2 1/2" BLOW-OFF TEMP END INSTALLATION  
STEEL PIPE**

**B-561**

